



## Technical Data Sheet

# *Zeta 50 / 50K*



**Zeta 50 / 50K** Is used for the non-destructive measurement of insulation resistance in electrical systems, at machines, transformers and cables.

### Special Features

- Test voltages up to 5000V
- Discharge of capacitive devices under taste
- Measurement cables with heavy duty insulation and needle gauge with LEDs

## Application

**Zeta 50/50K** Insulation measurement for cables, motors etc.

## Product Features

<b>Test Voltages to 5000 V</b>	This instrument is suited for the non-destructive measurement of insulation resistance in electrical systems, at machines and transformers and in cables, as well as within the electrical equipment of, for example, locomotives, tram systems and ocean going vessels, with eight selectable test voltages up to 5kV.	<b>Measurement Cables with Heavy-Duty Insulation</b>	The measurement cables with heavy-duty insulation are permanently connected for safety and technical reasons. Possible danger caused by the unintentional removal of cables is thus avoided, for example when charging occurs due to capacitive test objects.
<b>Voltage measurement to 2000 V</b>	With the voltage measuring ranges, test objects can be checked for the absence of voltage in networks of up to 2KV. This is important for insulation resistance measurement, because extraneous voltages distort measurement results.	<b>Needle Gauge with LEDs</b>	Three LEDs arranged within the needle gauge make reading easier. The lamp lights up which is located next to the scale, which is assigned to the selected measuring range. During the measurement sequence, the green LED indicates whether or not the battery charge is sufficient for the measurement.
<b>Discharge of Capacitive Devices Under Test</b>	Capacitive devices under test such as cables and coils, which might be discharged to test voltage, are discharged by the measuring instrument. The drop in voltage can be observed at the needle gauge.	<ul style="list-style-type: none"> <li>• Broad measuring range from 10KW to 1TW</li> <li>• Easy to read logarithmic display</li> <li>• Test voltages : 100V, 250V, 500V, 1000V, 1500V, 2000V, 2500V,5000V</li> <li>• Measurement to 2000V in accordance with DIN VDE 0413</li> <li>• Measuring range : 100kW to 100MW (1000V)</li> <li>• Voltage measurement to 2000V @</li> <li>• Guard Terminal eliminates surface current</li> <li>• Power supply with batteries or Crank Generator (Optional) or mains operated (Optional)</li> </ul>	
<b>Measurement in accordance with EN61557 part 1 and 2/ IS 2992 (VDE 0413)</b>	Measuring current is equal to 1mA at a test voltage of 100V, 250V, 500V and 1000V.		

## Technical Specifications

Reference Conditions		Standard Scope of Supply	
Ambient Temperature	+ 23°C ± 2K	1 High-voltage insulation tester with permanently connected measurement cables and test probes, 2 crocodile clips (5 kV version) and plug in battery module including batteries	
Relative Humidity	45 ... 55%	1 Carrying strap	
Measured Quantity Frequency	50Hz ± 10Hz (for voltage measurements)	1 Operating instructions	
Line Voltage Waveform	Sine, deviation between effective and rectified	1 Test certificate	
value < 1% Battery Voltage	8V ± 1%	<b>Note :</b> 3 Pin Mains Power Cable is Provided with Instrument. Earth is Mandatory for Mains Operated Instrument.	
Operating position	Horizontal	Ambient Conditions	
Power Supply Voltage (Mains)	9V	Operating Temperature	0 °C ... +40 °C
Electrical Safety		Storage Temperature	-20°C... +60°C (without batteries)
Protection Class	II	Relative Humidity	max. 75% condensation must be avoided
Test Voltage	8.5kV~	Elevation	up to 2000m
Overvoltage Category	2000V CAT II or 5000V CAT I	Power Supply (Mains)	
Fouling Factor	2	Nominal Power (Mains)	230V AC, ± 15%, 50Hz
Protection	IP 52	Nominal Voltage	9V

## Technical Specifications

### Applicable Regulations and Standards

IEC61010-1 EN61010-1 VDE0411-1	Safety regulations for electrical measurement, control, regulation and lab devices
DIN VDE0413 Part 1	Devices for the testing of safety requirements for electrical systems Insulation measuring devices
IEC61557 / IS 2992 EN61557 VDE0413  Part 1 Part 2	Measuring and monitoring facilities for testing the electrical safety in lines with nominal voltages up to AC1000V and DC1500V - General - Insulation resistance measuring devices
IEC/EN61326-1	Generic Emission Standard; Electrical equipment for measurement, control and laboratory use
IEC/EN61326/A1	Generic Immunity Standard; Electrical equipment for measurement, control and laboratory use
DIN EN60529  DIN VDE0470  part 1	Test instruments and test procedures - degree of protection provided by enclosures (IP code)
DIN EN60051	Direct-acting and direct-display electrical measurement devices and their accessories

### Mechanical Design

Dimensions	W x D x H 290mm x 250mm x 140mm
Weight	3.4Kg with batteries 4.5Kg (Mains operated + Batteries)

### Mechanical Design

Dimensions	W x D x H 290mm x 250mm x 140mm
Weight	3.4Kg with batteries 4.5Kg (Mains operated + Batteries)





### Power Supply (Battery)

Standard or Storage Battery	6 nos. 1.5V single cell per IEC R20
Working range	6V ... 10V
Battery service life	100 hours for no-load and Intermittent operation 7500 measurements for test voltage of 1000V with meas. Resistance of 1MW 15000 measurements for test voltage of 500V with meas. resistance of 500KW measurement of 5s-pause 25s
Battery charging time	8 -15 Hrs
Crank generator (Optional)	2 to 3 r.p.s With moderate strength. The W LED ON signals sufficient Crank frequency and consequently the validity of measuring values
Nominal Voltage	7.5V (at approx. 2.5 r.p.s)
Nominal Power	4W (at approx. 2.5 r.p.s)

### Electromagnetic Compatibility (EMC)

Interference emission	IEC/EN 61326-1
Interference immunity	IEC/EN 61326/A1

### Accessories

1) Crank Generator	
2) Carrying Case	
3) 3 pin Power Supply Cable	
4) Rechargeable Battery (Additional)	

## Technical Specifications

### Measuring Ranges

#### Insulation Resistance (For Battery + Crank Generator)

Scale / Standard	Nominal / Open-Circuit Voltage $U_N / U_O$	Meas. Range	Nom. Current $I_N$	S. C. Current $I_k$	Intrinsic Error <sup>1)</sup>	Deviation
① VDE0413	100V / 250V / 500V / 1000V	100KΩ ... 100MΩ	1mA	1.3mA	± 2.5%	± 30% of rdg.
②	100V / 250V / 500V / 1000V	10KΩ... 1TΩ	1mA	1.3mA	± 5%	
②	1500V 2000V 2500V 5000V	10KΩ... 1TΩ	1.3KΩ... 1TΩ	1.3mA	± 5%	

#### Insulation Resistance (For Mains)

Scale / Standard	Nominal / Open-Circuit Voltage $U_N / U_O$	Meas. Range	Nom. Current $I_N$	S. C. Current $I_k$	Intrinsic Error <sup>1)</sup>	Deviation
① VDE0413	100V / 250V / 500V / 1000V	100KΩ ... 100MΩ	1mA	1.3mA	± 2.5%	± 30% of rdg.
②	100V / 250V / 500V / 1000V	10KΩ... 1TΩ (except 10KΩ)	1mA	1.3mA	± 5%	
②	1500V 2000V 2500V 5000V	10KΩ... 1TΩ (except 10KΩ)	0.7mA 0.5mA 0.4mA 0.1mA	1.3mA	± 5%	
②	100V / 250V / 500V / 1000V 1500V 2000V 2500V 5000V	10KΩ...	1mA 1mA 0.7mA 0.5mA 0.4mA 0.1mA	1.3mA	± 6.5%	

#### Direct and Alternating Voltage


Measuring range	Frequency	Internal resistance	Max. allowable voltage	Intrinsic error <sup>1)</sup>
0...2000V AC/DC	15...500Hz	5M	2200VAC/DC max. 10s	± 5%

<sup>1)</sup>referring to scale length


## Technical Specifications

### Display

Movement	Core-magnet moving-coil mechanism
Scale length	111.5mm (longest scale)

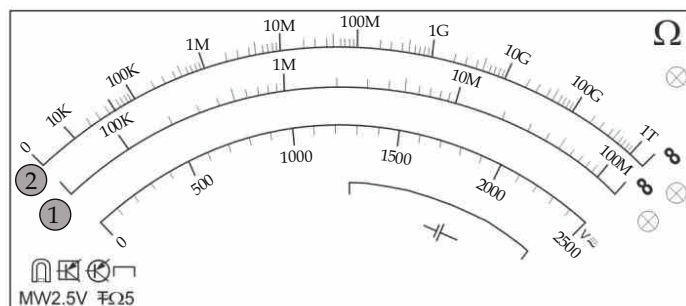

### U-R Diagram for Zeta Insu 5000A

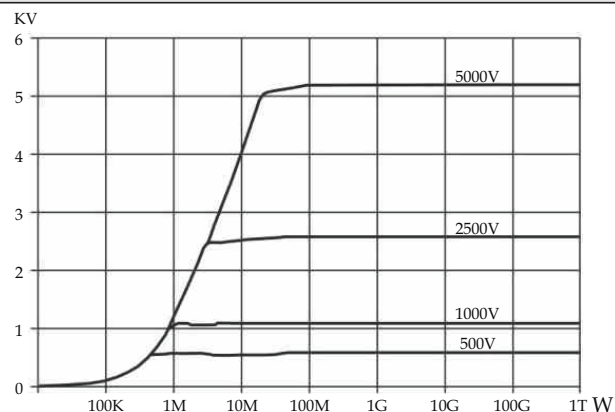

## Ordering Information

ZT50 - 1NS0000000000	Zeta 50	Zeta 50, 5000A STD High - voltage insulation tester for battery operation
ZT50 - 1BS0000000000		Zeta 50, 5000A Bull Dog clip STD
ZT50 - 2NS0000000000	Zeta 50K	Zeta 50K, 5000AK STD High -voltage insulation tester for hand crank generator operation
ZT50 - 2BS0000000000		Zeta 50K, 5000AK Bull Dog clip STD High -voltage insulation tester for hand crank generator operation



**sifam tinsley**  
PRECISION INSTRUMENTATION

### Sifam Tinsley Instrumentation Ltd

1 Warner Drive, Springwood Industrial Estate,  
Braintree, Essex CM7 2YW

Contact No. : +44 (0) 1376 335271

Email: [sales@sifamtinsley.com](mailto:sales@sifamtinsley.com)

[www.sifamtinsley.co.uk](http://www.sifamtinsley.co.uk)