



sifam tinsley
PRECISION INSTRUMENTATION

MULTIFUNCTION METER
www.sifamtinsley.co.uk



DATASHEET

Issue 1

**NEW
PRODUCT**



Multifunction Meters
Transducers & Isolators
Temperature Controllers
Converters & Recorders
Digital Panel Meters
Current Transformers
kWh Energy Meters
Analogue Panel Meters
Shunts
Digital Bargraphs
Digital Multimeters
Protection Relays
Synchroscope Series
Rotary Switches
Power Supplies
Test & Measurement

ND45PLUS POWER NETWORK ANALYSER

SUBJECT TO CHANGE WITHOUT NOTICE

This datasheet superseded all previous versions – please keep for future reference

Product Features:


- Wide supply voltage range:
 - 95...235V a.c. or 90...300V d.c.
 - 24V d.c. (option)
- Measurement and recording of over 500 electric energy quality parameters acc. to EN 50160,
- EN 61000-4-30 standards.
- Measuring class A*.
- Operation in 3 or 4-wire, 3-phase, balanced or unbalanced power networks.
- Analysis of current and voltage harmonics and interharmonics up to the 51 st for class I.
- Flicker.
- 4-quadrant energy measurement in 4 tariffs.
- Monitoring up to 6 additional energy meters with pulse output.
- Recording of measurements before and after events (dips & swells).
- Configurable archives of actual values and events recording.
- Data archiving on an SD card - memory up to 32 GB.
- E-mail messages in case of alarm occurs.
- Web server (HTTP protocol), FTP server, DHCP client.
- Interfaces: RS-485 Modbus Slave, Ethernet 100 Base-T (Modbus TCP/IP), USB Device & Host.
- Colour touch screen: LCD TFT 5.6", 640 x 480 pixels.
- IP54 protection grade from the frontal side.
- Time synchronisation using an external GPS receiver - STR receiver (optional).
- Automatic synchronization of RTC clock with the NTP time server.
- IEC 60870-5-104 communication protocol for data transmission in industrial process control systems and energy sector.

* for selected parameters - details in the technical data

ND45PLUS POWER NETWORK ANALYSER



Example of Application

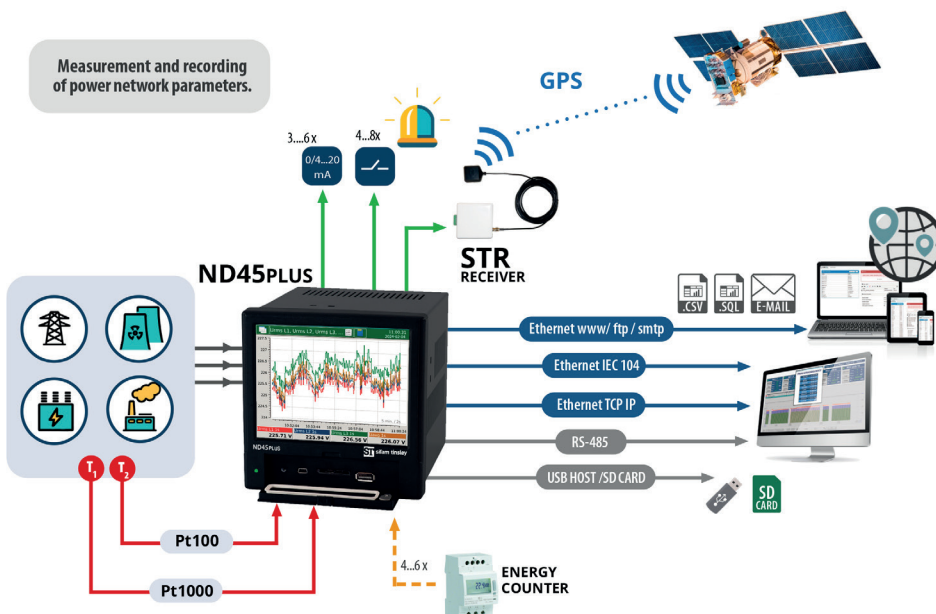

Measurement and Visualization of Power Network Parameters

Aggregated values for 3 seconds, 10 minutes and two hours:

- Phase voltages $U_1, U_2, U_3, U_{123} \text{ avg}$
- Phase current $I_1, I_2, I_3, I_{123} \text{ avg}$
- Active phase powers $P_1, P_2, P_3, \Sigma P_{123}, P_{123} \text{ avg}$
- Reactive phase powers $Q_1, Q_2, Q_3, \Sigma Q_{123}, Q_{123} \text{ avg}$
- Apparent phase powers $S_1, S_2, S_3, \Sigma S_{123}, S_{123} \text{ avg}$
- Active power factors $PF_1, PF_2, PF_3, PF_{123} \text{ avg}$
- Power factor distortion $dPF_1, dPF_2, dPF_3, dPF_{123} \text{ avg}$
- Reactive/active power factors $tgj_1, tgj_2, tgj_3, tgj_{123} \text{ avg}$
- Phase-to-phase voltages $U_{12}, U_{31}, U_{23}, U_{123} \text{ avg}$
- Current in neutral wire I_n
- The angle between the voltage and current $j_1, j_2, j_3, j_{123} \text{ avg}$ (degrees and radians)
- Voltage phase-to-phase angle $\angle U_{12}, \angle U_{31}, \angle U_{23}, \angle U_{123} \text{ avg}$


Other parameters:

- Frequency (aggregation for 1 and 10 seconds)
- Temperature/ resistance values (two channels)
- Demand values: P, Q, S, U, I (15-minute, 30-minute or 1 hour).
- Energy: active imported/exported, reactive imported/exported and apparent. All energies are calculated for each phase and 3-phase parameters.
- Factors: THD, THDS, THDG, PWHD. Calculated for currents and voltages of each phase and 3-phase parameters.
- Harmonics from 1 up to 51st for each phase of currents and voltages
- Interharmonics from 1 up to 51st for each phase of currents and voltages
- The half wave voltage of each phase
- Recording of dips, swells and over voltages
- Storage of minimum and maximum of measured values.


Features




Inputs



Outputs



Galvanic Isolation



Technical Data

Inputs	Measuring Ranges			Parameters	Basic Error
Voltage input	230/400 V	57,7/100V	69.3/ 120 V	0.05..1.5 Un	± 0.1%
Current input	1 A or 5A			0.005..1.5 In	± 0.1%
Logic input (option)	4 or 6 logic inputs: 0/5..24 V d.c.			switching frequency up to 50 Hz	
Input for temperature measurement	2 inputs: Pt100 (-200...850°C) lub Pt1000 (-200...850°C) , resistance: 0...5000 Ω				± 0.1%
Outputs					
Output type	Properties				
Analogue output (option)	3 or 6 programmable current outputs 0/4...20 mA, load resistance < 500 Ω				
Relay output (option)	4 or 8 programmable electromagnetic relays, voltageless NO contacts, load capacity 250 V a.c./1 A a.c.				
Digital Interfaces					
Interface type Properties					
RS-485	interface: Modbus Slave, baud rate 300...115200 bit/s, transmission mode ASCII/RTU				
USB 2	interfaces: Device & Host, USB v.2.0				
Ethernet	100 Base-T, RJ45 socket, Modbus TCP/IP, web server (HTTP), FTP server, DHCP client				
Rated Operating Conditions					
Supply voltage	85 V..253 V a.c., 40...400Hz	90 V..300 V d.c		power consumption ≤ 20 VA	
Ambient temperature	work: 0 up to 50°C			storage: - 20...50°C	
Relative humidity	< 75%			Condensation inadmissible	
Reaction against	supply decays			Data and device state preservation	
	supply recovery			Continuation of device work	
Short term load (5s)	2 Un (max. 1000 V)			10 In	
Casing protection grade	IP 54				
Safety requirements	Installation category III			EN 61010-1	
	Pollution grade 2				
Maximum phase-to-earth operating voltage	RS485, temperature/resistance input, USB: 50V			EN 61010-1	
	measuring circuit, relays, supply: 300 V				

Measuring Ranges and Admissible Basic Conversion Errors			
Measuring quantity	Measurement method	Range	Basic error
Voltage U RMS	U RMS averaged values: 200 ms class: B 1 s class: B 3 s class: A or S 10 min class: A or S 2 hrs class: A or S	U RMS L-N (150% Un) Un = 230 V 23.0..46..345.0 V (Ku=1) ..1.38 MV (Ku≠1) Un = 57.7V 5.7..11.5 ..86.5 V (Ku=1) ..280 kV (Ku≠1) Un = 69.3V 6.9..13.9 ..104.0 V (Ku=1) ..416 kV (Ku≠1) U RMS L-L (150% Un): Un = 400 V 40.0..80.. 600.0 V (Ku=1) ..2.4 MV (Ku≠1) Un = 100V 10.0 ..20..120.0 V (Ku=1) ..480 kV (Ku≠1) Un = 120V 12.0 ..24..180.0 V (Ku=1) ..720 kV (Ku≠1)	class A acc. to EN 61000-4-30 U RMS L-N (10% U _{din} - 150% U _{din}): ±0.1% U _{din} .
	I RMS: averaged values: 200 ms class: B 1 s class: B 3 s class: A or S 10 min class: A or S 2 hrs class: A or S	I RMS (150% In): In = 1 A - 0.010..0.1..1.5 A (Ki=1) In = 5 A - 0.050..0.5..7.5 A (Ki=1) ..480.0 kA (Ki≠1)	I RMS (10% In - 150% In): ±0.1% of measurement

Measuring quantity	Measurement method	Range	Basic error
Frequency	Class S appointed from 10 or 12 cycles in 200 ms.	42.5 up to 57.5 Hz for 50 Hz a.c. of supply	Class S acc. to EN 61000-4-30 ±0.050 Hz
	Class A appointed from 100 or 120 cycles in 10 s.	51.0 up to 69.0 Hz for 60 Hz a.c. of supply	Class A acc. to EN 61000-4-30 ±0.010 Hz
Active, reactive and apparent power	Active power: Measured every 10 cycles (50 Hz) or 12 cycles (60 Hz) Reactive power: appointed from apparent and active power. Apparent power: appointed from value U RMS and I RMS.	Depends on voltage and actual ratio value.	acc. to EN 61557-12: Active power: ± 0.5% P _n Reactive power: ± 1% Q _n Apparent power: ± 0.5% S _n
Active imported/ exported energy, reactive imported/ exported energy, apparent energy	Measured every 10 cycles (50 Hz) or 12 cycles (60 Hz). Separate measurement for exporten, imported active and reactive energy .	Depends on voltage and actual ratio value.	acc. to EN 61557-12: Active power: ± 0,5% Reactive power: ± 1% Apparent power: ± 2%
Active power factor, Power distortion factor	Active power factor : depends on U RMS, I RMS and active power. Power distortion factor depends on THD I.	-1,000 .. 0 .. 1,000	Power factor PF ± 0.01% Power distortion factor PF _{dist} ± 0.05%
Harmonics of voltages and current	acc. to EN 61000-4-7, up to 51st harmonic Window: 10 cycles (for 50 Hz), 12 cycles (for 60 Hz). FFT: 4096 points	Voltage harmonics: 0.00 .. 100.00 % Current harmonics: 0.00 .. 100.00 %	Voltage harmonics – class I ± 5% U _{rdg} if U _{rdg} > 1% ± 0.05% U _n if U _{rdg} < 1% Current harmonics – class I ± 5% U _{rdg} if U _{rdg} > 3% ± 0.5% U _n if U _{rdg} < 3%
THD U, THD I, THDG U, THDG I, THDS U, THDS I, PWHD U, PWHD I	acc. to EN 61000-4-7, up to 51st harmonic Window: 10 cycles (for 50 Hz), 12 cycles (for 60 Hz). FFT: 4096 points	THD U: 0.00 .. 100.00 % THD I: 0.00 .. 100.00 % THDG U: 0.00 .. 100.00 % THDG I: 0.00 .. 100.00 % THDS U: 0.00 .. 100.00 % THDS I: 0.00 .. 100.00 % PWHD U: 0.00 .. 100.00 % PWHD I: 0.00 .. 100.00 %	THD U: ±5% (50/60Hz) THD I: ±5% (50/60Hz) THDG U: ±5% (50/60Hz) THDG I: ±5% (50/60Hz) THDS U: ±5% (50/60Hz) THDS I: ±5% (50/60Hz) PWHD U: ±5% (50/60Hz) PWHD I: ±5% (50/60Hz)

where:

K_u - voltage transformer ratio

K_i - current transformer ratio

U_{din} - declared input voltage

U_{rdg}, I_{rdg} - measurement values

U_n, I_n, P_n, Q_n - nominal values








Various forms of data display:

- Digital display
- Analogue view
- Bargraphs
- Vector diagrams
- Trends
- Energy meter
- Harmonics analysis
- Energy meter.

Screen system log files.

Screens log alarms.

Control panel.

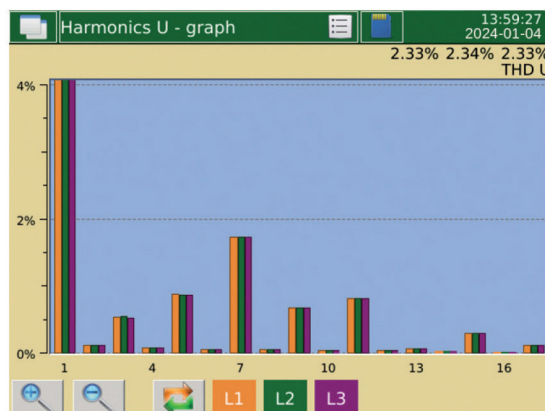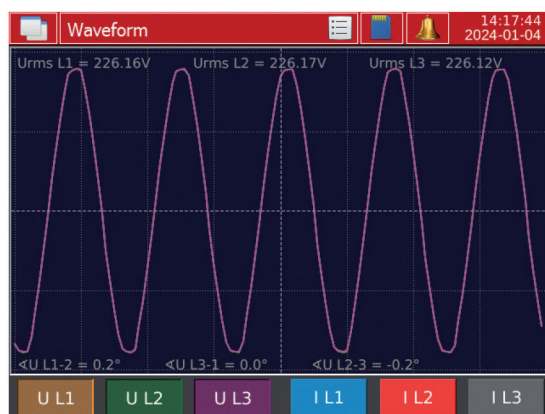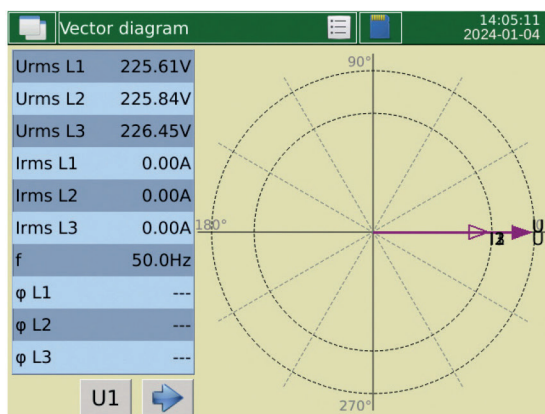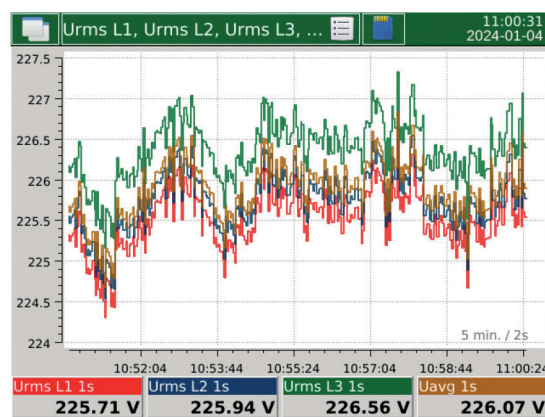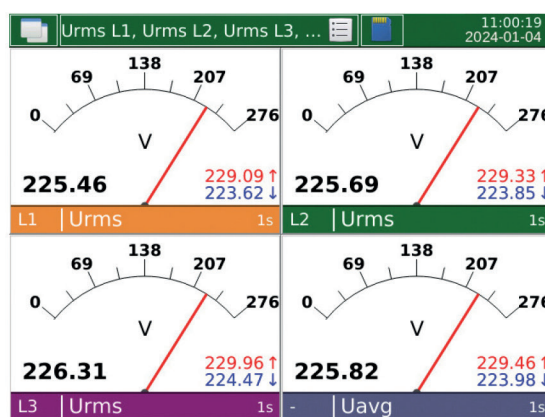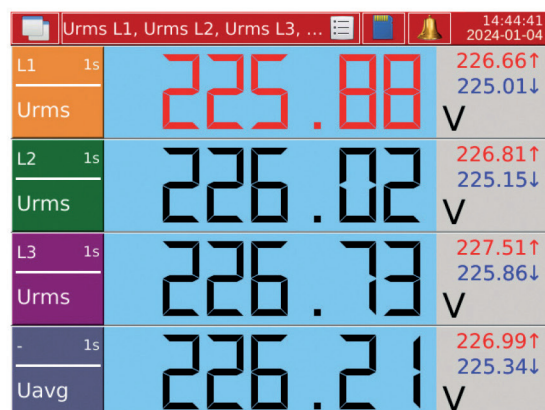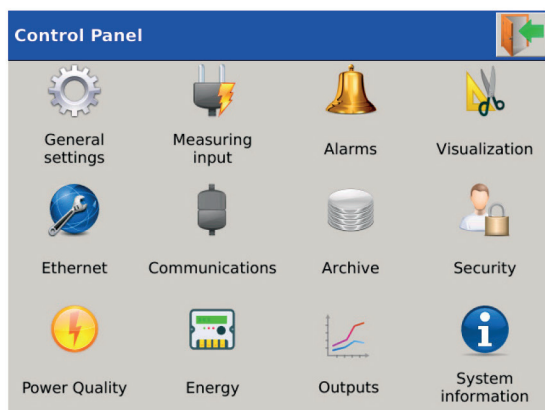

Harmonics U - table				
	L1 [%]	L2 [%]	L3 [%]	
THD	2.34	2.35	2.34	
THDG	2.34	2.35	2.34	
THDS	0.00	0.00	0.00	
PWHD	2.34	2.35	2.34	
1	100.00	100.00	100.00	
2	0.05	0.04	0.05	
3	0.78	0.79	0.78	
4	0.02	0.02	0.02	
5	0.63	0.63	0.63	
6	0.02	0.02	0.02	
7	1.78	1.79	1.78	
8	0.03	0.03	0.03	
9	0.66	0.66	0.66	
10	0.03	0.03	0.03	

Examples of Measuring Data Presentation

Energy			13:08:41 2024-01-04
	value	unit	
Σ EnP+	00000000.0	kWh	
L1	00000000.0	kWh	
L2	00000000.0	kWh	
L3	00000000.0	kWh	
Σ EnP-	00000000.0	kWh	
L1	00000000.0	kWh	
L2	00000000.0	kWh	
L3	00000000.0	kWh	
Σ EnQ+	00000000.0	kVARh	
L1	00000000.0	kVARh	

Binary inputs				14:07:45 2024-01-04
	BI1		BI2	
	1		0	
	BI3		BI4	
	0		0	
	BI5		BI6	
	0		0	

Alarm logs				14:18:23 2024-01-04
No	Date	Time	Description	
43	2016-01-20	13:49:54	Alarm 2 - Wł. (Urms L2 200ms 224.811V) (> 210)	
42	2016-01-20	13:49:54	Alarm 1 - Wł. (Urms L1 200ms 224.823V) (> 200)	
41	2016-01-20	08:53:15	Alarm 1 - Wł. (Urms L1 200ms 240.477V) (> 200)	
40	2016-01-19	16:00:19	Alarm 2 - Wł. (Urms L2 200ms 229.91V) (> 210)	
39	2016-01-19	16:00:19	Alarm 1 - Wł. (Urms L1 200ms 229.898V) (> 200)	
38	2016-01-19	15:36:32	Alarm 2 - Wł. (Urms L2 200ms 228.824V) (> 210)	
37	2016-01-19	15:36:31	Alarm 1 - Wł. (Urms L1 200ms 228.798V) (> 200)	
			Alarm 2 - Wł. (Urms L2 200ms	

Ethernet: www server, FTP

10.0.17.101/main

ND45PLUS

Admin

Dane pomiarowe

Wartości 1s

1s

Nazwa	Wartość
Urms L1 1s	222.63V
Urms L2 1s	222.64V
Urms L3 1s	222.59V
Uavg 1s	222.62V
Irms L1 1s	0.0000A
Irms L2 1s	0.0000A
Irms L3 1s	0.0000A
Iavg 1s	0.0000A
Ufund L1 1s	222.59V
Ufund L2 1s	222.61V

Alarmy

Alarm 1 (Urms L1 200ms = 226.055V) (> 200) 07:37:39

Alarm 2 (Urms L2 200ms = 226.071V) (> 210) 07:37:39

Potwierdź

Pliki: /ND45PLUS

Nazwa

Data modyfikacji

Rozmiar

2024-05-27 08_16_46.ND45Arch

2024-05-27 08:08:32


10.0 kB

Issue 1.0

MULTIFUNCTION METER

6

Dimensions and Assembly

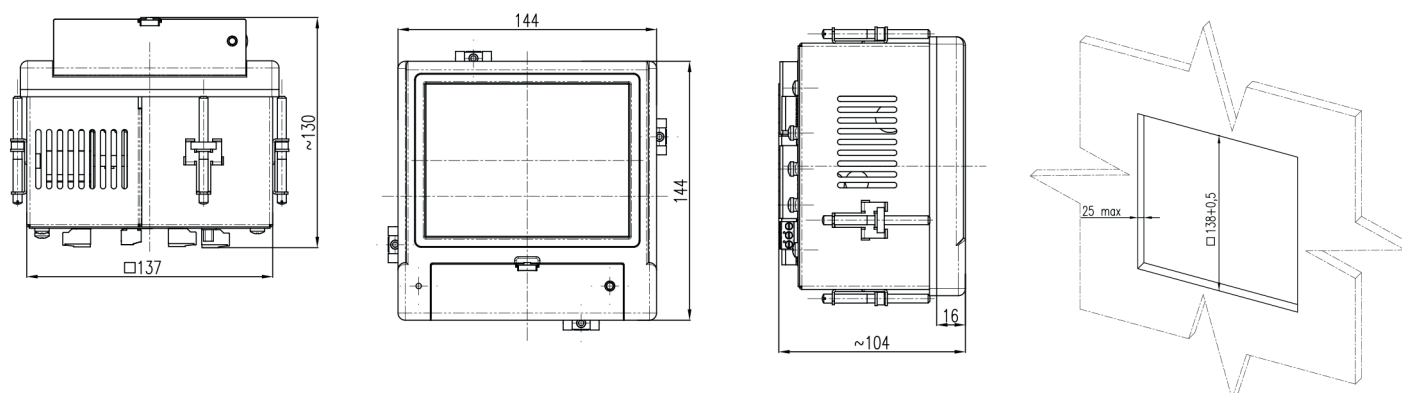

Ordering Code

Power Network Analyser ND45Plus

Code	Description
ND45PLUS 1010M000*	Power Network Analyser/ Recorder ND45PLUS Input current 1A/5A, X/1A, X/5A, Input voltage 3x57.7/100V, Measuring class S, Ethernet, RS485, USB interfaces, memory up to 32GB, supply 85-253V a.c. or 90-300V d.c., documentation and descriptions in Polish and English version, test certificate
ND45PLUS 1011M000*	Power Network Analyser/ Recorder ND45PLUS Input current 1A/5A, X/1A, X/5A, Input voltage 3x57.7/100V, Measuring class A/S, Ethernet, RS485, USB interfaces, memory up to 32GB, supply 85-253V a.c. or 90-300V d.c., documentation and descriptions in Polish and English version, test certificate
ND45PLUS 2010M000*	Power Network Analyser/ Recorder ND45PLUS Input current 1A/5A, X/1A, X/5A, Input voltage 3x230/400V, Measuring class S, Ethernet, RS485, USB interfaces, memory up to 32GB, supply 85-253V a.c. or 90-300V d.c., documentation and descriptions in Polish and English version, test certificate
ND45PLUS 2011M000*	Power Network Analyser/ Recorder ND45PLUS Input current 1A/5A, X/1A, X/5A, Input voltage 3x230/400V, Measuring class A/S, Ethernet, RS485, USB interfaces, memory up to 32GB, supply 85-253V a.c. or 90-300V d.c., documentation and descriptions in Polish and English version, test certificate

* Upon agreement, an option to order a calibration certificate for the product is available against payment. Then, in the execution code, in the place of the last character, enter the digit **2**, e.g. **ND45PLUS 2011M002**. The customer will then receive a standard test certificate and a calibration certificate (against payment).

* By agreement, an option to order the analyser with IEC 104 communication protocol is available for a fee. In this case, the value **03**, e.g. **ND45PLUS 2011M030**, should be entered in the version code in place of the penultimate character.

* Upon agreement, an option to order the analyser with 24 V DC power supply is available for an additional fee. In this case, the digit **2** must be entered as the third character in the model code, e.g., **ND45PLUS 2021M000**.

Accessories

Description	GPS SIGNAL RECEIVER	ADAPTER TO CONNECT A GPS RECEIVER
Code	STR 00M0*	CZ/20-001-00-00004
View		
Technical data	Receiver type: 50 channels GPS L1 C/A Accuracy: 2.5 m CEP Digital interface: RS-485 Voltage: 9...28 V d.c. Power consumption: < 2 VA Ambient temp: -20...60°C Dimensions: 71 x 71 x 27 mm Weight: < 0.3 kg	JACK 3.5 mm, plug with 3 screw terminals Dimensions: 12 x 18 x 43 mm Weight: 0.009 kg

* **Note:** The adapter is not included with the STR receiver and must be purchased separately.

Contact



Sifam Tinsley Instrumentation Ltd

1 Warner Drive
Springwood Industrial Estate
Braintree
Essex
CM7 2YW

Tel: 01376 335271
Email: sales@sifamtinsley.com

www.sifamtinsley.co.uk